

HGT 1053-3

10.1" Handheld Operating Panel

INSTRUCTION MANUAL

Article number:	01-245-1053-3-E
Date of creation:	20.03.2025
Version date:	06.08.2026



Publisher:

SIGMATEK GmbH & Co KG
A-5112 Lamprechtshausen
Tel.: +43/6274/4321
Fax: +43/6274/4321-18

Email: office@sigmatek.at
www.sigmathek-automation.com

All rights reserved. No part of this work may be reproduced, edited using an electronic system, duplicated or distributed in any form (print, photocopy, microfilm or in any other process) without express permission.

We reserve the right to make changes in the content without notice. SIGMATEK GmbH & Co KG is not responsible for technical or printing errors in this handbook and assumes no responsibility for damages that occur through its use.

10.1" Handheld Operating Panel

HGT 1053-3

The HGT 1053-3 is an intelligent panel for visualizing, operating and monitoring automated processes. Process diagnostics is therewith simplified.

The handheld operating panel has the following Safety components:

- Emergency stop switch
- Key switch
- Confirmation switch

A projective capacitive touch screen serves as the input medium for process data and parameters. The output is shown on a 10.1-inch TFT color display (WXGA 1280 x 800) with LED backlighting.

With the LASAL visualization tool, graphics can be created on the PC, then stored and displayed on the handheld operating panel. The available interfaces can be used to exchange process data or configure the handheld operating panel. The operating system, application and application data are stored on the internal storage medium.

The Safety functions can be implemented via the connection to a Safety controller SCP XXX.

The connector cable is optionally available with various connectors.



Table of Contents

1 Introduction	5
1.1 Target Group/Purpose of this Operating Manual	5
1.2 Important Reference Documentation	5
1.3 Contents of Delivery	5
2 Basic Safety Directives	6
2.1 Symbols Used	6
2.2 Disclaimer	7
2.3 General Safety Directives	7
2.4 Designated Use	9
2.5 Software/Training	10
3 Standards and Directives	11
3.1 Residual Risks	11
3.2 Safety of the Machine or Equipment	11
3.3 Regular Technical Inspection of Safety-oriented Switches	12
3.4 Directives	12
3.4.1 Functional Safety Standards	12
3.4.2 EU Declaration of Conformity	13
3.5 Safety-Relevant Parameters	13
4 Type Plate	14
5 Technical Data	15
5.1 Performance Data	15
5.2 Electrical Requirements	16
5.3 Display	17
5.4 Control Unit	18
5.5 Minimum Distance between Operating Elements for Multi-touch Applications	19
5.6 Input	19
5.7 Environmental Conditions	20
5.8 Miscellaneous	20
6 Interfaces	21
6.1 Connections Bottom	21
6.1.1 X1: USB Interface 2.0 Type A	21

6.2 Rear Connectors	22
6.2.1 X2: M16 Cable Connector	22
6.3 Status Display LEDs	23
6.4 Key Switch	24
6.5 Confirmation Switch	25
6.6 Emergency Stop	26
7 Mechanical Dimensions	27
8 Assembly/Installation	28
8.1 Check Contents of Delivery	28
8.2 Cooling	28
8.3 Wall Mount	29
9 Wiring	30
9.1 Recommended Shielding	30
9.1.1 Connection from the Control Cabinet to the HGT 1053-3	30
9.2 ESD Protection	30
9.3 USB Interface	31
10 Process Diagram	32
11 Status and Error Messages	33
12 Operation/Start-up	41
12.1 Note	41
12.2 Operation	41
12.2.1 General	41
12.2.2 Evaluating Operating Elements	42
13 Transport/Storage	43
14 Storage	44
15 Maintenance	45
15.1 Cleaning and Disinfecting the Touch Screen	45
15.2 Service	45
15.2.1 Calibrating the Touch Screen	46
15.3 Repair	46
16 Buffer Battery	47
16.1 Data Retention Battery Change	47

16.2 Exchanging the Battery	48
17 microSD Card	49
17.1 Exchanging the microSD Card	49
18 Display „Burn-In“ Effect	51
18.1 Screen Saver	51
19 Disposal	52
20 Accessories	53
20.1 Touch Pen	53
20.2 Edge Protection	53
20.3 Battery	53
20.4 microSD Card	54
21 Application Information	55
21.1 Configuring Safety Components	55
21.1.1 Minimum System Requirements	55
21.1.2 Adding the HGT 1053-3 to a SAFETYDesigner Project	55
21.1.3 Key Switch	55
21.1.4 Confirmation Switch	55
21.1.5 Emergency Stop	55
21.2 Storage Media	56
21.2.1 Create Boot Media (Make Bootdisk)	56
21.2.2 Lifetime Calculation (Flash Media Lifetime Calculation)	57
21.3 HW Facts	57

1 Introduction

1.1 Target Group/Purpose of this Operating Manual

This operating manual contains all information required for the operation of the product.

This operating manual is intended for:

- Project planners
- Technicians
- Commissioning engineers
- Machine operators
- Maintenance/test technicians

General knowledge of automation technology is required.

Further help and training information, as well as the appropriate accessories can be found on our website www.sigmatek-automation.com.

Our support team is happily available to answer your questions or assist you in case of any issues. Please see our website for our hotline number and business hours.

1.2 Important Reference Documentation

- Safety System Handbook
- Documentation Connection Cables for Operating Devices
- HW IP Address Settings

This and additional documents can be downloaded from our website or obtained through support.

1.3 Contents of Delivery

1x HGT 1053-3

2x keys

2 Basic Safety Directives

2.1 Symbols Used

The following symbols are used in the operator documentation for warning and danger messages, as well as informational notes.

DANGER



Danger indicates that death or serious injury **will occur**, if the specified measures are not taken.

→ To avoid death or serious injuries, observe all guidelines.

Danger indique une situation dangereuse qui, faute de prendre les mesures adéquates, **entraînera** des blessures graves, voire mortelles.

→ Respectez toutes les consignes pour éviter des blessures graves, voire mortelles.

WARNING



Warning indicates that death or serious injury **can** occur, if the specified measures are not taken.

→ To avoid death or serious injuries, observe all guidelines.

Avertissement d'une situation dangereuse qui, faute de prendre les mesures adéquates, **entraînera** des blessures graves, voire mortelles.

→ Respectez toutes les consignes pour éviter des blessures graves, voire mortelles.

CAUTION



Caution indicates that moderate to slight injury **can** occur, if the specified measures are not taken.

→ To avoid moderate to slight injuries, observe all guidelines.

Attention indique une situation dangereuse qui, faute de prendre les mesures adéquates, **peut** entraîner des blessures assez graves ou légères.

→ Respectez toutes les consignes pour éviter des blessures graves, voire mortelles.

DANGER



Danger for persons with pacemakers, implanted defibrillators or other active implants.

Danger pour les personnes portant un stimulateur cardiaque, un défibrillateur implanté ou d'autres implants actifs.

WARNING



Magnetic field warning

Alerte au champ magnétique

CAUTION

Danger for ESD-sensitive components.

Les signes de danger pour les composants sensibles aux décharges électrostatiques.

INFORMATION**INFORMATION**

- Provides important information on the product, handling or relevant sections of the documentation, which require particular attention.

2.2 Disclaimer

The contents of this operating manual were prepared with the greatest care. However, deviations cannot be ruled out. This operating manual is regularly checked and required corrections are included in the subsequent versions. The machine manufacturer is responsible for the proper assembly, as well as device configuration. The machine operator is responsible for safe handling, as well as proper operation.

The current operating manual can be found on our website. If necessary, contact our support.

Subject to technical changes, which improve the performance of the devices. The following operating manual is purely a product description. It does not guarantee properties under the warranty.

Please thoroughly read the corresponding documents and this operating manual before handling a product.

SIGMATEK GmbH & Co KG is not liable for damages caused through, non-compliance with these instructions or applicable regulations.

2.3 General Safety Directives

The Safety Directives in the other sections of this operating manual must be observed. These instructions are visually emphasized by symbols.

According to EU Directives, the operating manual is a component of a product. This operating manual must therefore be accessible in the vicinity of the machine since it contains important instructions. This operating manual should be included in the sale, rental or transfer of the product, or its online availability indicated.

Regarding the requirements for Safety and health connected to the use of machines, the manufacturer must perform a risk assessment in accordance with machine directives 2006/42/EG before introducing a machine to the market.

INFORMATION

Operate the unit with devices and accessories approved by SIGMATEK only.

CAUTION

Handle the device with care and do not drop or let fall.
Prevent foreign bodies and fluids from entering the device.
The device must not be opened!

Manipulez l'appareil avec précaution et ne le laissez pas tomber.
Empêchez les corps étrangers et les liquides de pénétrer dans l'appareil.
L'appareil ne doit pas être ouvert!

If the device does not function as intended or has damage that could pose a danger, it must be replaced!

En cas de fonctionnement non conforme ou de dommages pouvant entraîner des risques, l'appareil doit être remplacé !

Regularly check the housing for mechanical damage.

Vérifier régulièrement l'absence de dommages mécaniques sur le boîtier.

The handheld operating panel may only be used within the visible area for the application to control. The system integrator must perform a risk assessment.

Le pupitre de commande manuel ne doit être utilisé que dans la zone visible pour l'application à commander. Une évaluation des risques doit être effectuée par l'intégrateur du système.

For your own safety and that of others, compliance with the environmental conditions is essential.

Pour votre propre sécurité et celle des autres, le respect des conditions environnementales est essentiel.

2.4 Designated Use

The Safety functions implemented in the product are designed for use with safety applications in a PLC control and meet the required conditions for safe operation.

CAUTION



The instructions contained in this operating manual must be followed. For error-free operation, proper transport and storage are essential.

Installation, mounting, programming, initial start-up, operation, maintenance and decommissioning can only be performed by qualified personnel.

Qualified personnel in this context are people, who have completed training or have trained under supervision of qualified personnel and have been authorized to operate and maintain safety-related equipment, systems and facilities in compliance with the strict directives and standards of safety technology (Functional Safety).

Les instructions contenues dans ce manuel technique doivent être suivies.

Pour un fonctionnement sans erreur, le transport et le stockage appropriés sont essentiels.

L'installation, le montage, la programmation, la mise en service initiale, l'exploitation, la maintenance et la mise hors service ne peuvent être effectués que par une personne qualifiée.

Dans ce contexte, on entend par personnel qualifié les personnes qui ont suivi une formation ou qui ont été formées sous la supervision d'un personnel qualifié et qui ont été autorisées à utiliser et à entretenir l'équipement, les systèmes et les installations de sécurité conformément aux directives et aux normes strictes de la technique de sécurité (Sécurité fonctionnelle).

For your own safety and that of others, the product should be used for their designated purpose only.

Correct EMC installation is also included under designated use.

Pour votre propre sécurité et celle des autres, le produit ne doivent être utilisés qu'à des fins prévues.

Une installation CEM correcte est également incluse dans l'utilisation prévue.

Non-designated use consists of:

- any changes made to the module or the use of damaged modules.
- use of the module inconsistent with the technical margins described in this operating manual or the specifications defined in the technical data.

L'utilisation non désignée consiste en:

- toute modification apportée au module ou l'utilisation des modules endommagés.
- utilisation du module non conforme aux marges techniques décrites dans ce manuel ou aux spécifications définies dans les données techniques.

CAUTION

As required by EN ISO 13850, section 4.1 and EN 60204-1, section 10.7.1, confusion between a functioning and non-functioning handheld operating panel is possible must be prevented.

Conformément à la norme EN ISO 13850, section 4.1 et EN 60204-1, section 10.7.1, la confusion entre un panneau de commande portatif fonctionnel et non fonctionnel doit être évitée.

If an operating panel is not coupled and not in use, keep it in a location with restricted access.

Si un panneau de commande n'est pas couplé et n'est pas utilisé, con-servez-le dans un endroit à accès restreint.

INFORMATION

Hardware and software features (application-specific data) can be found in chapter 21 Application Information.

2.5 Software/Training

The application is created with the software LASAL CLASS 2 and LASAL SCREEN Editor / VISU Designer (HTML5), the Safety application is created using the SAFETY Designer. Basic information on Safety (Functional Safety) can be found in the Safety System Handbook.

Training for the LASAL development environment, with which the product can be configured, is provided. Information on our training schedule can be found on our website.

3 Standards and Directives

3.1 Residual Risks



CAUTION

The following residual risks for the product must be included in the system integrator's risk assessment:

- Release of non-environmentally safe substances, emissions and unusual temperatures
- Hazardous contact voltages
- Effects of operational electrical, magnetic and electromagnetic fields
- Possible effects of information technology devices

Les risques résiduels suivants pour le produit doivent être inclus dans l'évaluation des risques de l'intégrateur de système :

- Libération de substances non respectueuses de l'environnement, émissions et températures inhabituelles
- Tensions de contact dangereuses
- Effets des champs électriques, magnétiques et électromagnétiques opérationnels
- Effets possibles des dispositifs de technologie de l'information

3.2 Safety of the Machine or Equipment

Observe all on-site rules and regulations for accident prevention and occupational safety.

3.3 Regular Technical Inspection of Safety-oriented Switches

CAUTION



According to the machine directive, mechanical and electromechanical safety-oriented components (e.g. relays, switches, etc.) must be regularly checked for correct function.

Emergency stop switch: at least 1x/month

Key switch: at least 1x/year

Confirmation switch: at least 1x/year

Conformément à la directive relative aux machines, le bon fonctionnement des composants mécaniques et électromécaniques liés à la sécurité (par exemple, relais, interrupteurs, etc.) doit être vérifié régulièrement.

Interrupteur d'arrêt d'urgence : au moins 1 fois par mois

Changement de clé : au moins 1 fois par an

Commutateur de confirmation : au moins 1 fois par an

Please note the requirements of your machine. Due to Type C standards or other directives, requirements could differ regionally.

Veuillez tenir compte des exigences relatives à votre machine. En raison des normes de type C ou d'autres directives, les exigences peuvent varier d'une région à l'autre.

3.4 Directives

The product was constructed in compliance with the following European Union directives and tested for conformity.

3.4.1 Functional Safety Standards

EN IEC 62061	Safety of machinery - Functional safety of safety-related control systems
EN ISO 13849-1	Safety of machinery - Safety-related parts of control systems - Part 1: General principles for design
EN ISO 13849-2	Safety of machinery - Safety-related parts of control systems - Part 2: Validation
EN ISO 13850	Safety of machinery - Emergency stop function - Principles for design
EN IEC 61508-1	Functional safety - Part 1: General requirements
EN IEC 61508-2	Functional safety - Part 2: Requirements for electrical / electronic / programmable electronic safety-related systems
EN IEC 61508-3	Functional safety - Part 3: Software requirements

The issue status of the applied standards can be found in the EU declaration of conformity.

3.4.2 EU Declaration of Conformity



EU Declaration of Conformity

The product HGT 1053-3 conforms to the following European directives:

- 2006/42/EG Machine Directive
- 2014/30/EU Electromagnetic Compatibility (EMC Directive)
- 2011/65/EU “Restricted use of certain hazardous substances in electrical and electronic equipment” (RoHS Directive)

The EU Conformity Declarations are provided on the SIGMATEK website. They can be found in the download area of the respective product.

3.5 Safety-Relevant Parameters

Input Module	Safety Parameters (SIL 3, HFT 1, PL e / Cat. 4 ¹⁾)
HGT 1053-3 incl. Safe CPU SCP XXX	PFH = 1.1E-11 (1/h) SFF = 99 % MTTF _D = 296 years DC = 99 %
Confirmation switch	B _{10D} = 100,000
Emergency stop switch	B _{10D} = 325,000
Key switch	B _{10D} = 10,000

¹⁾ Depending on the application, the probability of failure must be determined for the included electromechanical components based on the B_{10D} values listed here and included in the calculation for the entire system.

4 Type Plate

The type plate provides information about the product's features. The type plate shown here is only an example.

QR-Code

HW: X.XX SW: XX.XX.XXX

Safety Version: SXX.XX.XX

Serial No.

SIGMATEK GMBH & CO KG

Sigmathekstrasse 1 A-5112 LAMPRECHTSHAUSEN

Article Number

Product Name

Short Name

HW: Hardware version
FS: Safety version number
FW: Firmware version
LD: Logic device version
QR-Code: Serial number

5 Technical Data

5.1 Performance Data

Processor	EDGE3-Technology
Processor cores	4 ¹⁾
Internal program and data memory (RAM)	2-Gbyte (DDR4)
Internal remnant data memory	128-kByte FRAM
Internal storage device	8-Gbyte microSD (16-Gbyte 2:1 formatted ~60k P/E cycles) ²⁾
Optional memory expansion	no
Graphic	integrated in EDGE processor
Interfaces	1x Ethernet (10/100/1000) 1x USB 2.0 Type A 1x Safety Interface
Internal interface connections and devices	1x TFT color display 1x USB 2.0 Type A 1x USB (touch connection) 1x microSD card holder (SD 3.0)
Operating components	Confirmation switch (2 normally open contacts, 3-stage) Key switch (2 normally open contacts) Emergency stop switch (2 normally closed contacts)
Signal generator	no
Display Resolution	10.1" TFT color display WXGA 1280 x 800 pixels
Operating field	Touch screen (multi-touch, projective capacitive)
Status LEDs	Multi-LED (red/green)
Real-time clock	yes (battery buffered)
Cooling	semi-passive (fan activated only when required)

INFORMATION



The Safety interface must be used exclusively with the SCP XXX! The status of the Safety-oriented inputs is sent to the SCP XXX.

¹⁾ Attention: When programming on multi-core CPUs (with LASAL), particular focus must be placed on thread security!

²⁾ The internal storage medium is formatted in the specified ratio to increase its lifespan. Changing the format to the full storage medium size is not permitted and will result in a significant reduction in lifespan.

5.2 Electrical Requirements

Supply voltage	+24 V DC $\pm 20\%$ (SELV/PELV) UL: NEC Class 2	
Protection class	III	
Current consumption of power supply (+24 V)	typically 600 mA (with no external devices connected)	maximum 700 mA (with external devices connected)
Inrush current without current-limiting supply	maximum 9 A for $< 110\ \mu\text{s}$	
Inrush current with 24 V/10 A fixed voltage supply	maximum 1.9 A for $< 500\ \text{ms}$	

The specified supply voltage refers directly to the device connection. Take the generated voltage drop via the hybrid cable into consideration and if necessary, increase the required supply voltage.

INFORMATION



For USA and Canada:


Only suitable for connection to secondary isolated power supply rated 24 V DC, class 2 or fuse rated max. 4 A in accordance with UL 248 shall be connected in the field between the supply source and device terminals.

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

5.3 Display

Type	10.1" TFT color display
Resolution	WXGA 1280 x 800 pixels
Color depth	24-Bit RGB
LCD mode	normally black ¹⁾
LCD Polarizer	transmissive ²⁾
Pixel size	0.1695 x 0.1695 mm
Active range	216.96 x 135.6 mm
Backlighting	LED
Contrast ratio	typically 800:1
Brightness	typically 300 cd/m ²
Angle CR ≥ 10	from all sides 85° ³⁾
Life span	By compliance with the ambient conditions, the brightness of the display sinks after 20,000 operating hours to 50 % of the original brightness.

Due to the manufacturing process, individual pixel errors cannot be excluded to 100 % and therefore do not constitute a reduction in quality.

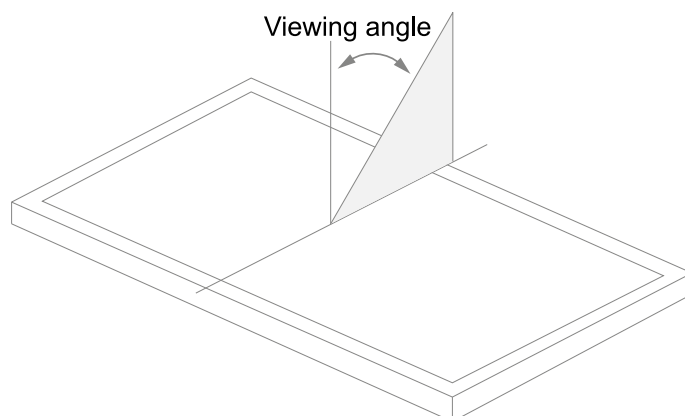

¹⁾ If there is no display data, the display remains black when the backlighting is on.

²⁾ Display technology, with which display backlighting is used.

³⁾ The viewing angle is measured from the normal to the display surface.

5.4 Control Unit

Operating field	Touch screen (multi-touch, projective capacitive)
Maximum number of fingers	10
The operation with thin gloves	yes
SIGMATEK Touch pen (passive)	yes
Handwriting recognition	no
Ball of the thumb recognition	no
Water spray recognition ¹⁾	yes
Water detection ²⁾	no
Cleaning	see chapter 15.1 Cleaning and Disinfecting the Touch Screen

INFORMATION




The device must always be grounded or with cable-connected devices, the mass must be connected correctly to ensure stable function of the touch screen. The touch function may still have to be individually adapted to the respective environmental conditions.

¹⁾ Detects individual water droplets on the touch screen and remains operable.

²⁾ Detects a large amount of water on the touch screen and deactivates it.

5.5 Minimum Distance between Operating Elements for Multi-touch Applications

To guarantee smooth operation with multi-touch applications, buttons and control elements that should be operated at the same time must have a realistic minimum clearance.

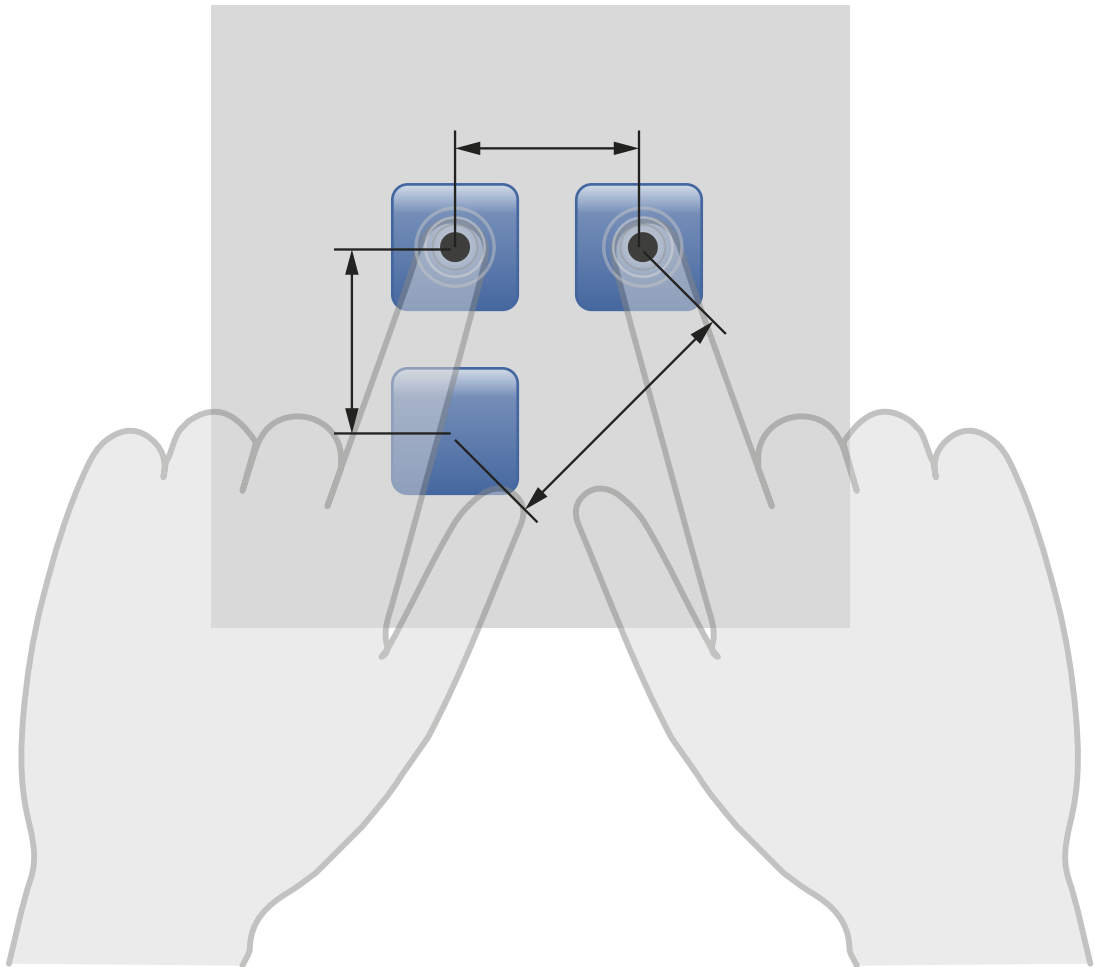

INFORMATION



The size of the buttons and operating elements directly affect the operability of the application. Small operating elements should therefore be avoided.

5.6 Input

Input	Multi-touch screen (PCAP)
Emergency stop switch	1
Confirmation switch	1 (3 switch positions with panic function)
Key switch	1 (2 switch positions)

5.7 Environmental Conditions


Storage temperature	-10 ... +70 °C	
Environmental temperature	0 ... +50 °C	
Humidity	10-95 %, non-condensing	
Installation altitude above sea level	0-2000 m without derating > 2000 m up to a maximum of 5000 m with derating of the maximum environmental temperature by 0.5 °C per 100 m	
Operating conditions	pollution degree 2	
Noise emissions	≤ 70 dB	
EMC resistance	EN 61000-6-2 (industrial area) (increased requirements according to EN IEC 62061)	
EMC noise generation	EN 61000-6-4 (industrial area) EN 61000-6-3 (residential area)	
Vibration resistance	EN 60068-2-6	3.5 mm from 5-8.4 Hz 1 g from 8.4-150 Hz
Shock resistance	EN 60068-2-27	15 g (147.15 m/s ²)
Protection type	EN 60529	IP54 (only with all protective in place) (not evaluated by UL)
Free fall (with rough handling)	DIN EN 60068-2-31	1000 mm
Free fall (with packaging)	IEC 60068-2-32	1000 mm

5.8 Miscellaneous


Article number	01-245-1053-3	
Operating system	Gecko	
Default IP address	10.10.150.1	
Printed circuit board coating	no	
Approvals	CE	yes
	UL	cULus (E247993)
	Functional Safety	yes
	UKCA	no
Mission time	20 years	

6 Interfaces

6.1 Connections Bottom

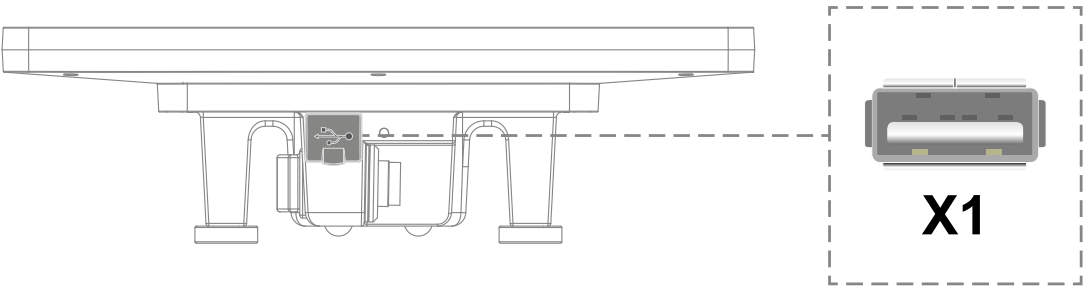

6.1.1 X1: USB Interface 2.0 Type A




Pin	Function
1	+5 V, $I_{out,max} = 500\text{ mA}$
2	D-
3	D+
4	GND




INFORMATION

It should be noted that many of the USB devices on the market do not comply with USB specifications; this can lead to device malfunctions. This may cause the device to malfunction. It is also possible that these devices will not be detected at the USB port or function correctly. It is therefore recommended that every USB stick or USB supply be tested before actual use.

6.2 Rear Connectors

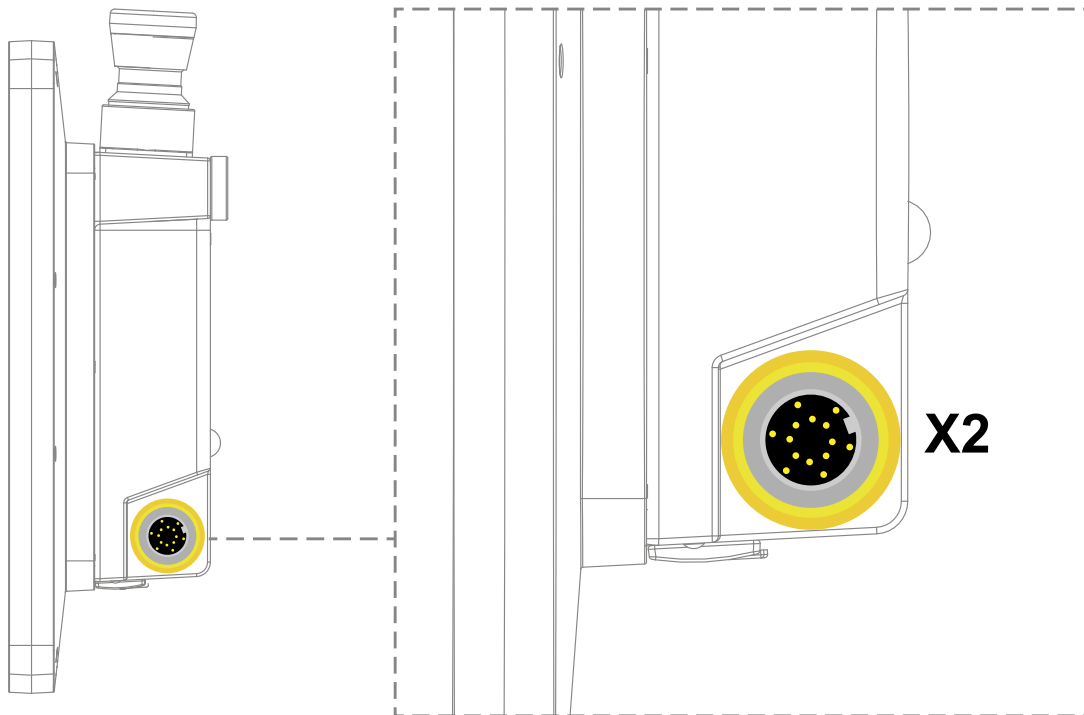

6.2.1 X2: M16 Cable Connector




Pin	Wire color	Function	
L	yellow	Safety interface H	
J	green	Safety interface L	
G	black	Safety interface shield	
E	red	+24 V DC	
C	black	GND	
A	shield	ETH shield	
U	white	Gigabit Ethernet	DA+/Tx+
T	red		DD+
S	blue		DD-
R	pink		DC-
P	grey		DC+
O	yellow		DB-/Rx-
N	green		DB+/Rx+
M	brown		DA-/Tx-

INFORMATION



Appropriate connector cables are optionally available. See documentation [Connection Cables for Operating Devices](#).

6.3 Status Display LEDs

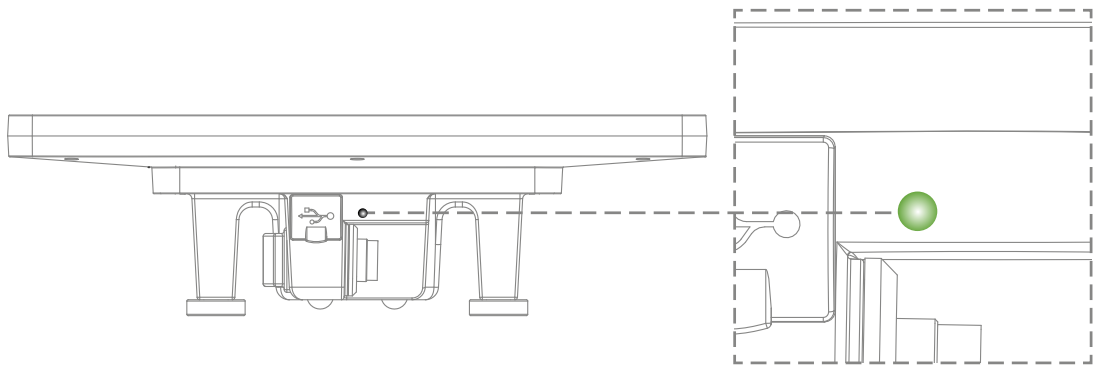

Multi-LED	Status
Lights green	- Supply voltage OK - During operating system start - Application running
Lights red	- Supply voltage NOT OK
Lights yellow	- Supply voltage OK - Operating system not started or still in Start mode
Blinks red	- Application error or reset


INFORMATION



Within the application, the multi-LED (green/red) can be controlled as desired.


6.4 Key Switch

The key switch is two-stage and evaluated via the SCP XXX connected to the HGT 1053-3.

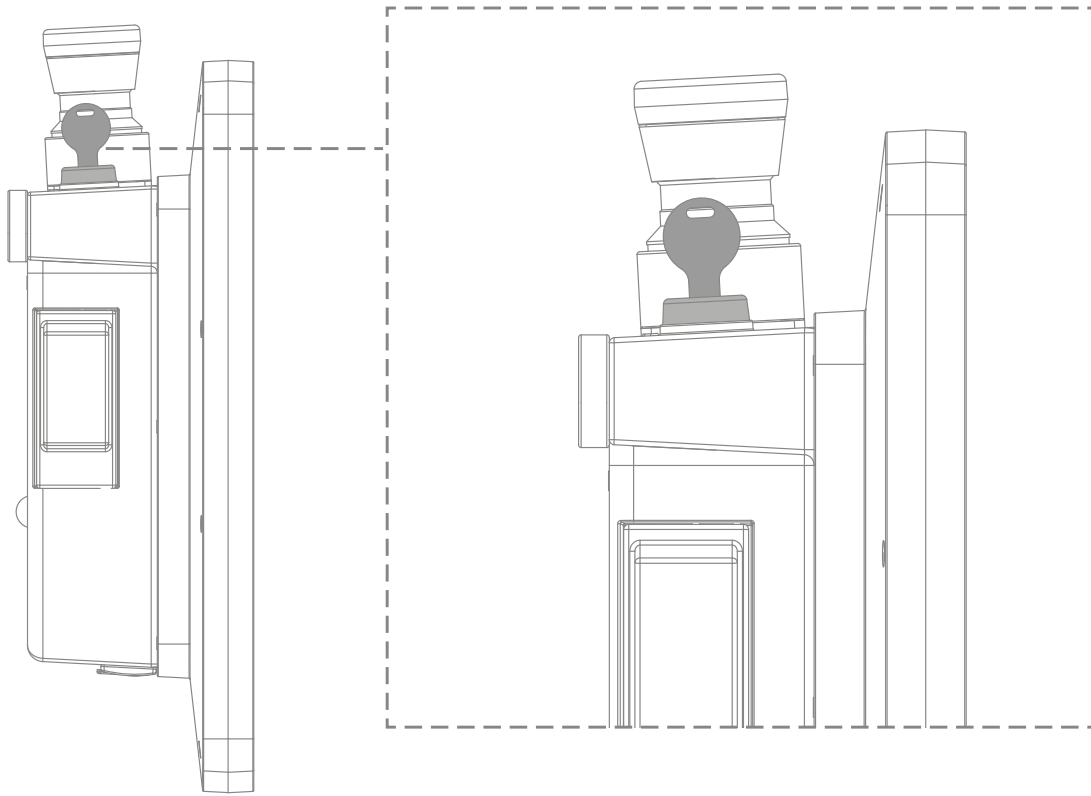

6.5 Confirmation Switch

The confirmation switch is three stage. If the switch is not pressed or pressed only partially, it is inactive. The switch is active when “simply” pressed (middle stage).

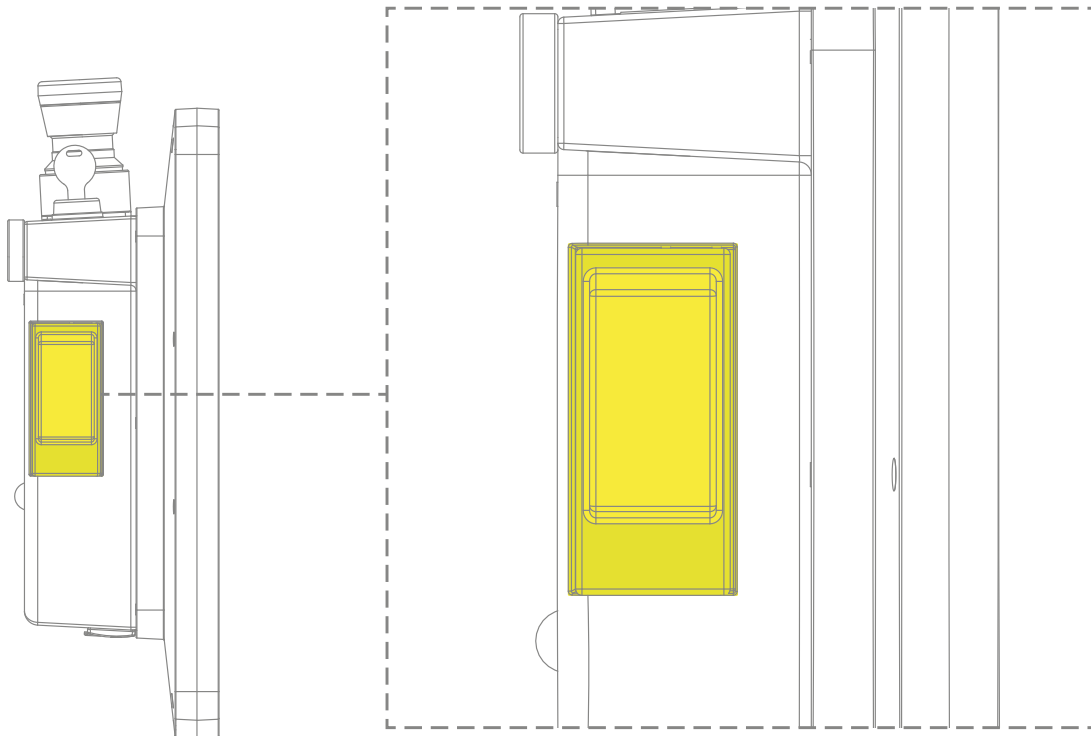

CAUTION



Activating the confirmation switch is a deliberate action. Do not press the confirmation switch for longer than required to confirm the affected operation.

L'activation du bouton de confirmation est une action délibérée. N'appuyez pas sur le bouton de confirmation plus longtemps que nécessaire pour confirmer l'opération concernée.


The confirmation switch is part of the safety-related feature. Only the person activating the confirmation switch may work in the danger zone.

L'interrupteur de confirmation fait partie du dispositif de sécurité. Seule la personne qui active l'interrupteur de confirmation est autorisée à travailler dans la zone dangereuse.


The confirmation switch can be operated with the hand used to hold the operating panel. The confirmation switch can be used as dead-man switch with a panic function.

6.6 Emergency Stop

The emergency stop has 2-channel construction.

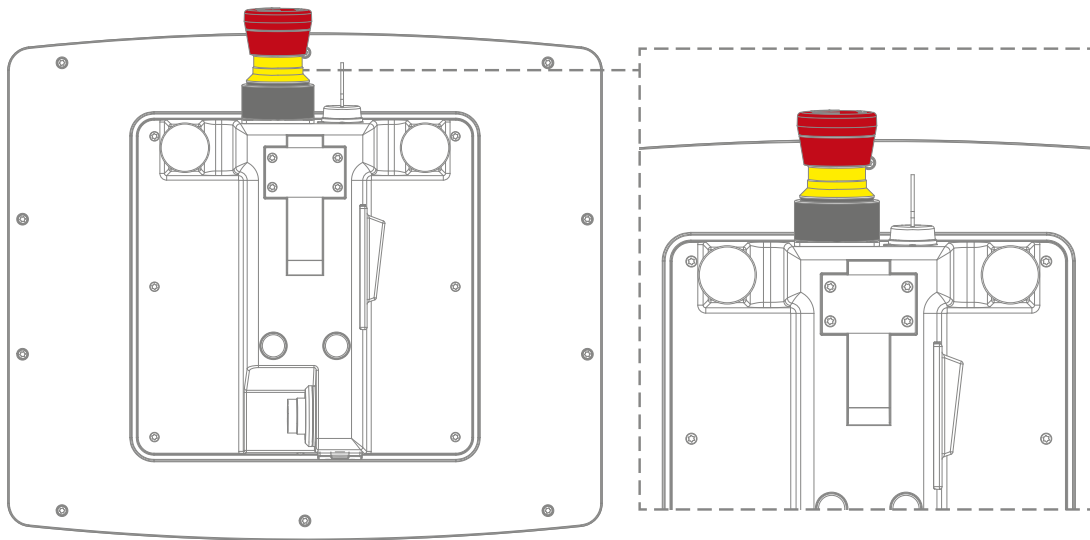

7 Mechanical Dimensions

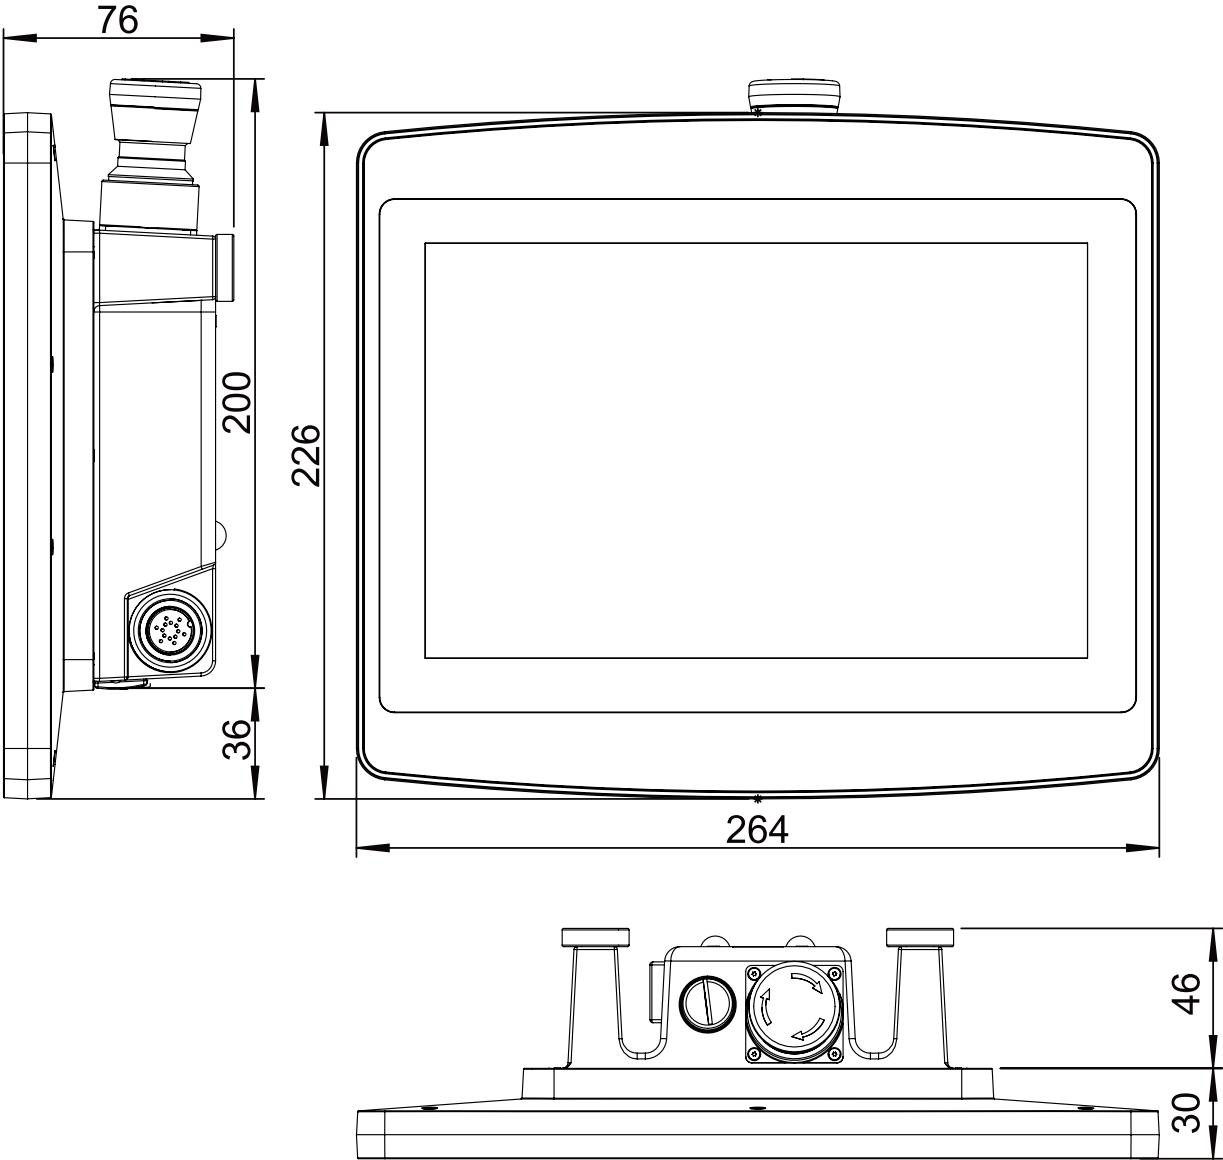

Dimensions	264 x 236 x 76 mm (W x H x D)
Material	Housing: PC/ASA Color: RAL7024 Front: glass 1.1 mm
Weight	1.25 kg

8 Assembly/Installation

8.1 Check Contents of Delivery

Ensure that the contents of the delivery are complete and intact. See chapter 1.3 Contents of Delivery.



INFORMATION

On receipt and before initial use, check the device for damage. If the device is damaged, contact our customer service and do not install the device in your system.

Damaged components can disrupt or damage the system.

8.2 Cooling

The cooling of the HGT 1053-3 is semi-passive (fan activated only when required).

The CPU is passively cooled until a critical core temperature is reached (mostly caused by a high CPU/GPU load and simultaneously, high ambient temperatures) The fan remains active until the CPU is cooled to a temperature that allows passive cooling. The device can therefore reliably operate at full capacity without performance loss at the maximum operating temperature and extend the lifespan of the the fan during idle times.


A fan is with a very high life expectancy is installed.

Life expectancy (continuous operation, fan)	
MTTF (MTBF) at 40 °C	550 000 h = circa 62 years
L10 at 40 °C	70 000 h = circa 8 years

The speed and status of the fan can be read via the device software (hardware class). A fan monitor can be thereby implemented, which warns the user of a defect.

8.3 Wall Mount

Using the corresponding wall mount, the panel can be attached to the provided holder (A1) on the back (see dimensions for counter piece).

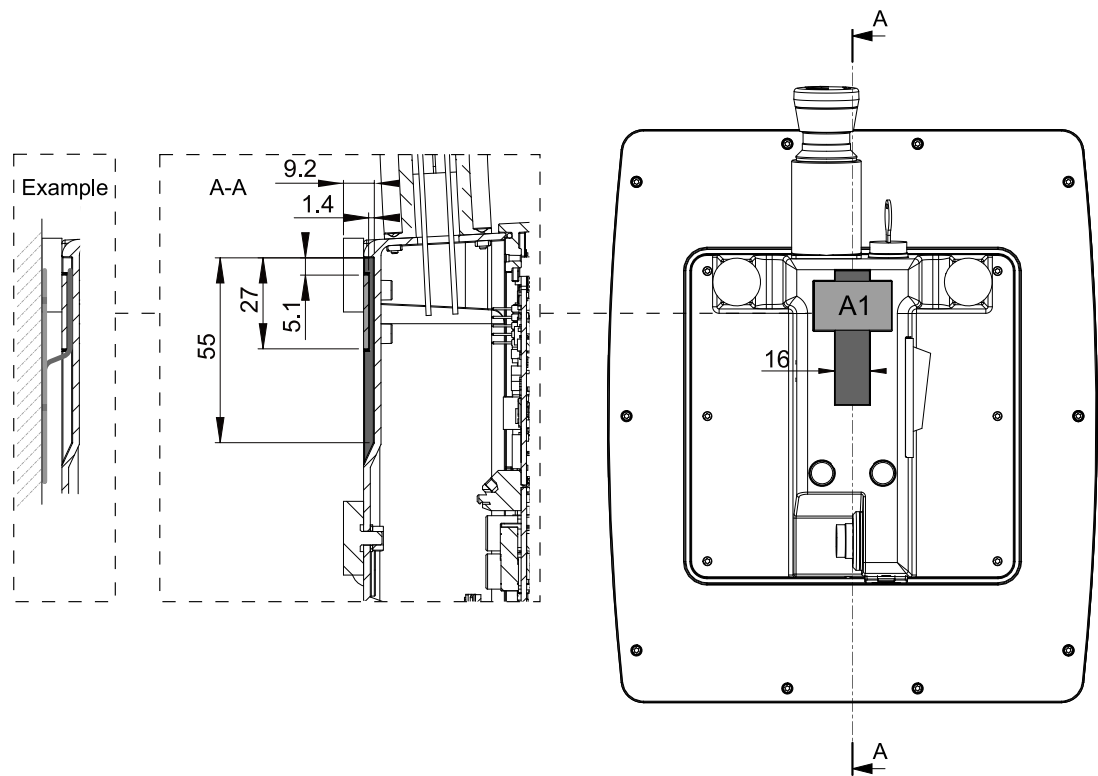

Symbol Image 10"


9 Wiring

9.1 Recommended Shielding

For applications in which the bus is operated outside the control cabinet, the correct shielding is required. This is especially important, if due to physical requirements, the bus cables must be placed next to sources of strong electromagnetic noise. It is recommended that wiring the connector cable in parallel with power cables be avoided whenever possible.

9.1.1 Connection from the Control Cabinet to the HGT 1053-3

It is recommended that the shielding be mounted at the entry point of the control cabinet housing. Noise can then be deflected from the electronic components before reaching the module.

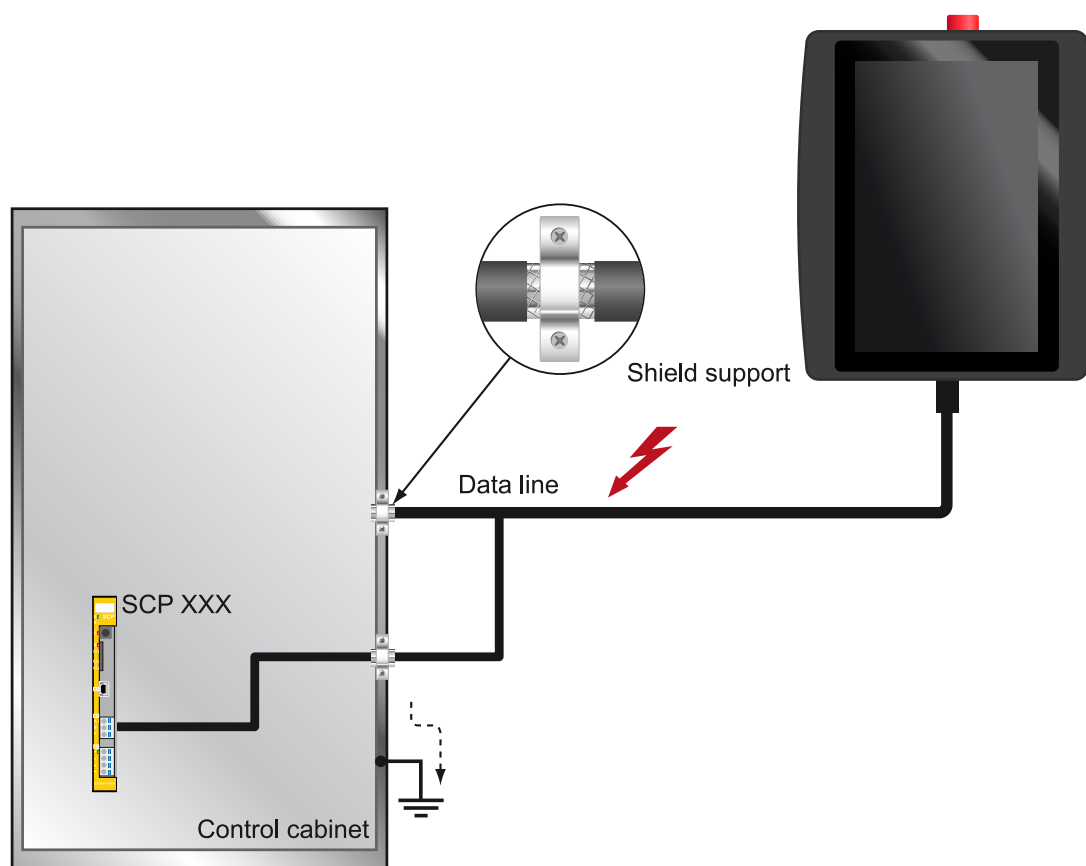

Schematic Representation

9.2 ESD Protection

CAUTION




The operator must ensure that no ESD interference affects the product.

L'opérateur doit s'assurer qu'aucune interférence due à des décharges électrostatiques n'affecte le produit.

9.3 USB Interface

The product has a USB interface. This interface can be used to connect various USB devices (keyboard, mouse, storage media, hubs, etc.). Several USB devices can be connected using a hub, which are then fully functional.

10 Process Diagram

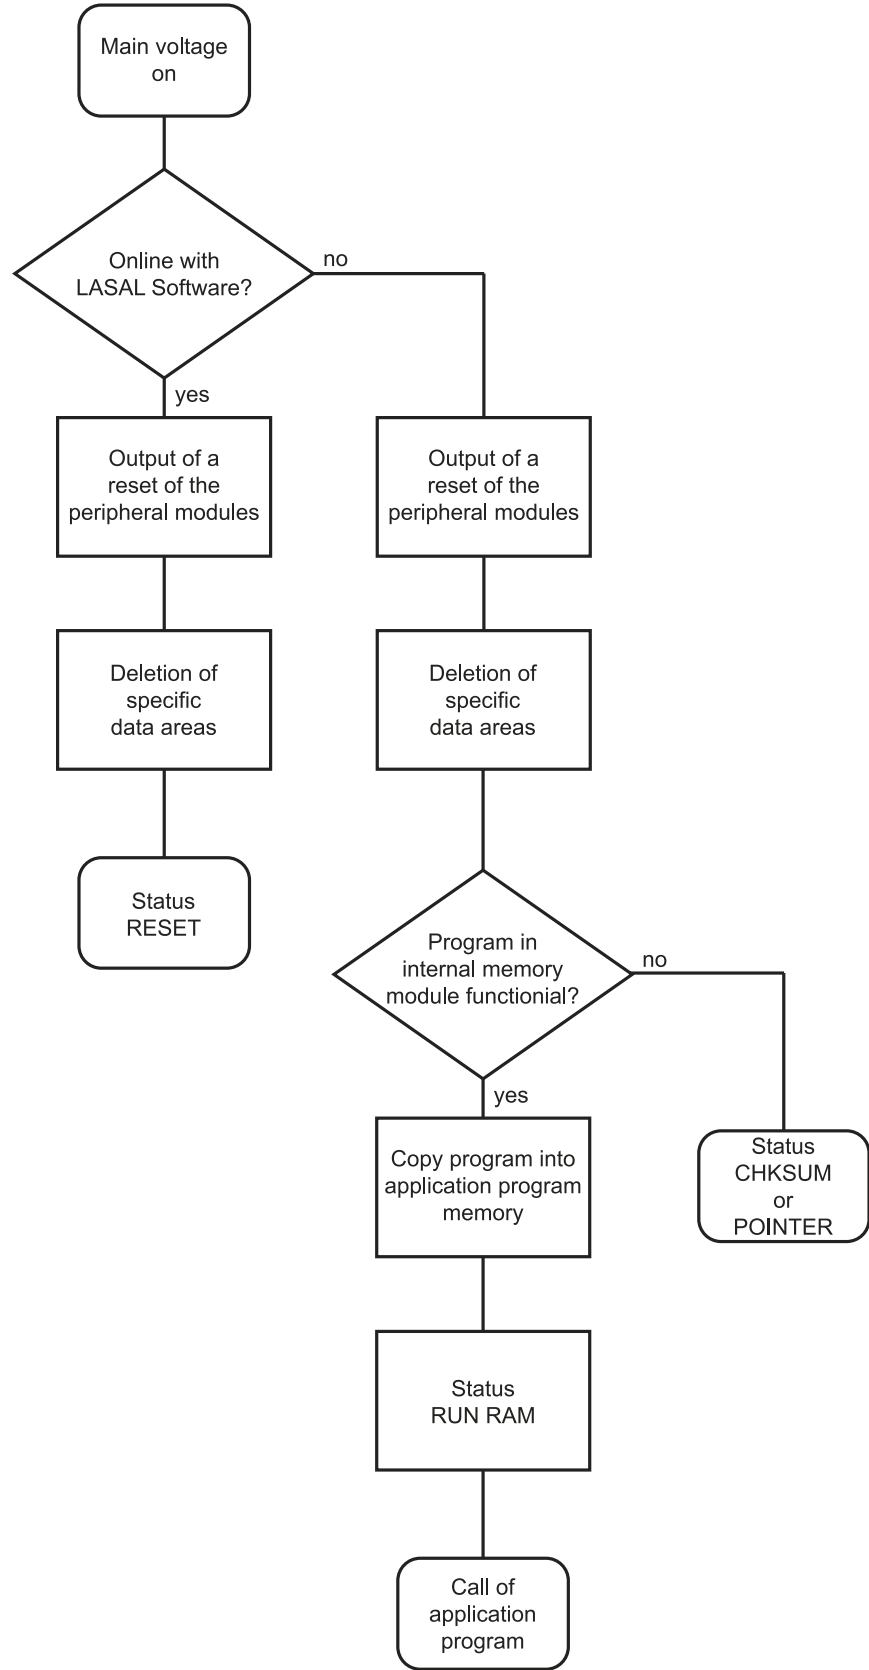

11 Status and Error Messages

Status and error messages are shown in the status test of the LASAL CLASS software. POINTER or CHKSUM messages can also be shown on the screen.

Number	Message	Definition	Cause/Solution
00	RUN RAM	The user program is currently running in RAM. The display is not affected.	Info
01	RUN ROM	The user program stored in the program memory module was loaded into the RAM and is currently running. The display is not affected.	Info
02	RUNTIME	The total time for all cyclic objects exceeds the maximum time; the time can be configured using 2 system variables: ■ Runtime: Remaining time ■ SWRuntime: Preset value for runtime counter	Solution: ■ Optimize the application's cyclic task. ■ Use higher capacity CPU. ■ Configure preset value
03	POINTER	Incorrect program pointers were detected before running the user program	Possible Causes: ■ The program memory module is missing, not programmed or defective. ■ The program in the user program memory (RAM) is not executable. ■ The buffer battery has failed. ■ The user program has overwritten a software error. Solution: ■ Reprogram the memory module, if the error reoccurs exchange the module. ■ Exchange the buffering battery ■ Correct programming error
04	CHKSUM	An invalid checksum was detected before running the user program.	Cause/Solution: s. POINTER

Number	Message	Definition	Cause/Solution
05	WATCHDOG	The program was interrupted via the watchdog logic.	Possible Causes: ■ User program interrupts blocked over a longer period of time (STI command forgotten). ■ Programming error in a hardware interrupt. ■ INB, OUTB, INW, OUTW instructions used incorrectly. ■ The processor is defective. Solution: ■ Correct programming error. ■ Exchange CPU
06	GENERAL ERROR	General error An error has occurred while stopping the application via the online interface.	This error occurs only during the development of the operating system.
07	PROM DEFECT	An error has occurred while programming the memory module.	Causes: ■ The program memory module is defective. ■ The user program is too large. ■ The program memory module is missing. Solution: ■ Exchange the program memory module
08	RESET	The CPU has received the reset signal and is waiting for further instructions. The user program is not processed.	Info
09	WD DEFECT	The hardware monitoring circuit (watchdog logic) is defective. After power-up, the CPU checks the watchdog logic function. If an error occurs during this test, the CPU deliberately enters an infinite loop from which no further instructions are accepted.	Solution: ■ Exchange CPU
10	STOP	The program was stopped by the programming system.	
11	PROG BUSY	Reserved	
12	PROGRAM LENGTH	Reserved	
13	PROG END	A memory module was successfully programmed.	Info
14	PROG MEMO	The CPU is currently programming the memory module.	Info

Number	Message	Definition	Cause/Solution
15	STOP BRKPT	The CPU was stopped by a breakpoint in the program.	Info
16	CPU STOP	The CPU was stopped by the programming software.	Info
17	INT ERROR	The CPU has triggered a false interrupt and stopped the user program or has encountered an unknown instruction while running the program.	Causes: ■ A nonexistent operating system was used. ■ Stack error (uneven number of PUSH and POP instructions). ■ The user program was interrupted by a software error. Solution: ■ Correct programming error.
18	SINGLE STEP	The CPU is in single step mode and is waiting for further instructions.	Info
19	READY :	A module or project has been sent to the CPU and it is ready to run the program.	Info
20	LOAD	The program is stopped and the CPU is currently receiving a new module or project.	Info
21	INVALID MODULE	The CPU has received a module that does not belong to the project.	Solution: ■ Recompile and download the entire project
22	MEMORY FULL	The operating system memory (heap) is too small. No memory could be reserved while calling an internal function or an interface function is called from the application.	Causes: ■ Memory is only allocated but not released. Solution: ■ Clear memory
23	NOT LINKED	When starting the CPU, a missing module or a module that does not belong to the project was detected.	Solution: ■ Recompile and download the entire project
24	DIV BY 0	A division error has occurred.	Possible Causes: ■ Division by 0. ■ The result of a division does not fit in the result register. Solution: ■ Correct programming error.
25	DIAS ERROR	While accessing a DIAS module, an error has occurred.	Hardware problem
26	WAIT	The CPU is busy.	Info

Number	Message	Definition	Cause/Solution
27	OP PROG	The operating system is currently being reprogrammed.	Info
28	OP INSTALLED	The operating system has been reinstalled.	Info
29	OS TOO LONG	The operating system cannot be loaded; too little memory.	Restart, report error to SIGMATEK.
30	NO OPERATING SYSTEM	Boot loader message, no operating system found in RAM.	Restart, report error to SIGMATEK.
31	SEARCH FOR OS	The boot loader is searching for the operating system in RAM.	Restart, report error to SIGMATEK.
32	NO DEVICE	Reserved	
33	UNUSED CODE	Reserved	
34	MEM ERROR	The operating system loaded does not match the hardware configuration.	Solution: Use the correct operating system version
35	MAX IO	Reserved	
36	MODULE LOAD ERROR	The LASAL Module or project cannot be loaded.	Solution: Recompile and download the entire project
37	BOOTIMAGE FAILURE	A general error has occurred while loading the operating system.	Contact SIGMATEK
38	APPLMEM ERROR	An error has occurred in the application memory (user heap).	Solution: Correct allocated memory access error
39	OFFLINE	This error does not occur in the control.	This error code is used in the programming system to show that there is no connection to the control.
40	APPL LOAD	Reserved	
41	APPL SAVE	Reserved	
44	VARAN MANAGER ERROR	An error number was entered in the VARAN manager and stopped the program.	Solution: Read LogFile
45	VARAN ERROR	A required VARAN client was disconnected or a communication error has occurred.	Solution: - Read LogFile - Error tree

Number	Message	Definition	Cause/Solution
46	APPL-LOAD-ERROR	An error has occurred while loading the application.	Cause: ■ Application was deleted. Solution: ■ Reload the application into the control.
47	APPL-SAVE-ERROR	An error has occurred while attempting to save the application.	
50	ACCESS-EXCEPTION-ERROR	Read or write access of a restricted memory area. (I.e. writing to the NULL pointer).	Solution: ■ Correct application errors
51	BOUND EXCEEDED	An exception error has occurred while accessing arrays. The memory area was overwritten by accessing an invalid element.	Solution: ■ Correct application errors
52	PRIVILEGED INSTRUCTION	An unauthorized instruction for the current CPU level was given. For example, setting the segment register.	Cause: ■ The application has overwritten the application program code. Solution: ■ Correct application errors
53	FLOATING POINT ERROR	An error has occurred during a floating-point operation.	
60	DIAS-RISC-ERROR	Error from the Intelligent DIAS Master.	Restart, report error to SIGMATEK.
64	INTERNAL ERROR	An internal error has occurred, all applications are stopped.	Restart, report error to SIGMATEK.
65	FILE ERROR	An error has occurred during a file operation.	
66	DEBUG ASSERTION FAILED	Internal error	Restart, report error to SIGMATEK.
67	REALTIME RUNTIME	The total duration of all real-time objects exceeds the maximum time; the time cannot be configured. 2 ms for 386 CPUs 1 ms for all other CPUs	Solution: ■ Optimize the application's real-time task (RtWork). ■ Reduce the clock time for the real-time task of all objects. ■ Correct application errors ■ CPU is overloaded in real-time => use a higher capacity CPU.
68	BACKGROUND RUNTIME	The total time for all background objects exceeds the maximum time; the time can be configured using 2 system variables: - BTRuntime: -SWBTRuntime: pre-selected value for the runtime counter	Solution: ■ Optimize the application's background task (background) ■ Use higher capacity CPU ■ Set SWBTRuntime correctly

Number	Message	Definition	Cause/Solution
70	C-DIAS ERROR	A connection error with a C-DIAS module has occurred.	Cause: ■ The cause of the error is documented in the log file Solution: ■ This depends on the cause
72	S-DIAS ERROR	A connection error with an S-DIAS module has occurred.	Possible Causes: ■ Real network does not match the project ■ S-DIAS client is defective Solution: ■ Analyze log file
75	SRAM ERROR	An error occurred while initializing, reading or writing SRAM data.	Possible Causes: ■ SRAM configured incorrectly ■ Battery for powering the internal program memory is empty Solution: ■ Analyze log file (Event00.log, Event19.log) ■ Check configuration ■ Exchange battery for powering the internal program memory
95	USER DEFINED 0	User-definable code.	
96	USER DEFINED 1	User-definable code.	
97	USER DEFINED 2	User-definable code.	
98	USER DEFINED 3	User-definable code.	
99	USER DEFINED 4	User-definable code.	
100	C_INIT	Initialization start; the configuration is run.	
101	C_RUNRAM	The LASAL project was successfully started from RAM.	
102	C_RUNROM	The LASAL project was successfully started from ROM.	
103	C_RUNTIME		
104	C_READY	The CPU is ready for operation.	
105	C_OK	The CPU is ready for operation.	
106	C_UNKNOWN_CID	An unknown object from a stand-alone or embedded object, or an unknown base class was detected.	

Number	Message	Definition	Cause/Solution
107	C_UNKNOWN_CONSTR	The operating system class cannot be created; the operating system is probably wrong.	
108	C_UNKNOWN_OBJECT	Indicates an unknown object in an interpreter program; more the one DCC080 object.	
109	C_UNKNOWN_CHNL	The hardware module number is greater than 60.	
110	C_WRONG_CONNECT	No connection to the required channels.	
111	C_WRONG_ATTR	Wrong server attributes.	
112	C_SYNTAX_ERROR	Non-specific error. Recompile and download all project sections.	
113	C_NO_FILE_OPEN	An attempt was made to open an unknown table.	
114	C_OUTOF_NEAR	Memory allocation failed	
115	C_OUT OF_FAR	Memory allocation failed	
116	C_INCOMAPTIBLE	An object with the same name already exists but has a different class.	
117	C_COMPATIBLE	An object with the same name and class exists but must be updated.	
224	LINKING	The application is currently linking.	
225	LINKING ERROR	An error has occurred while linking.	
226	LINKING DONE	Linking is complete.	
230	OP BURN	The operating system is currently being burned into the Flash memory.	
231	OP BURN FAIL	An error has occurred while burning the operating system.	
232	OP INSTALL	The operating system is currently being installed.	
240	USV-WAIT	The power supply was disconnected; the UPS is active. The system is shutdown.	
241	REBOOT	The operating system is restarted.	

Number	Message	Definition	Cause/Solution
242	LSL SAVE		
243	LSL LOAD		
252	CONTINUE		
253	PRERUN	The application is started.	
254	PRERESET	The application is ended.	
255	CONNECTION BREAK		

12 Operation/Start-up

12.1 Note

WARNING



The operating panel can be mounted onto magnetic components, for example, directly on the machine.

Caution must be taken to ensure that no magnetically sensitive objects are located in the immediate vicinity of the HGT 1053-3 (e.g. credit / magnetic stripe cards).

Le panneau de commande peut être monté sur des composants magnétiques, par exemple directement sur la machine.

Veiller à ce qu'aucun objet magnétiquement sensible ne se trouve à proximité immédiate de HGT 1053-3 (p. ex. cartes de crédit / cartes à bande magnétique).

DANGER



This device is equipped strong magnets, which can pose a danger to people with implants such as pacemakers!

Cet appareil est équipé d'aimants puissants, ce qui peut représenter un danger pour les personnes porteuses d'implants tels que les stimulateurs cardiaques!

12.2 Operation

12.2.1 General

The Safety functions (key switch, confirmation switch, emergency stop) are not functional at the time of delivery and must be defined by the applications engineer via programming. In order to use the Safety functions, a safety-related control SCP XXX is required. See chapter 21 Application Information.

The HGT 1053-3 is operated via the touch screen.

INFORMATION



To avoid damage to the touch screen, it can only be operated using the fingers or an appropriate stylus. Suitable gloves are also permitted for the touch technology, as long as they do not damage the device (e.g. via chips, pointed or similar objects).

CAUTION

Do not lay the operating panel on its touch screen. Also avoid laying anything on top of the touch screen.

This can cause operating errors, undesired triggering of functions or damage to the device.

Ne posez pas le panneau de commande sur son écran tactile. Évitez également de poser quoi que ce soit sur l'écran tactile. Cela peut entraîner des erreurs de fonctionnement, des déclenchements intempestifs de fonctions ou des dommages sur l'appareil

Do not place the panel on loose or unstable surfaces. It could fall onto the floor and be subsequently damaged.

Ne placez pas le panneau sur des surfaces lâches ou instables. Il pourrait tomber sur le sol et être endommagé par la suite.

The operating panel is constructed to that it can be operated by right and left handers equally.

CAUTION

Typically, USB devices (keyboard, mouse etc.) are equipped with non-shielded cables. These devices are disrupted by ESD and in some instances, no longer function.

Généralement, les périphériques USB (clavier, souris etc) ne sont pas équipés de câbles blindés. Ces dispositifs sont perturbés par des décharges électrostatiques et, dans certains cas, ne fonctionnent plus.

Before any device is connected to, or disconnected from the product, the potential should be equalized (by touching the control cabinet or ground terminal). Electrostatic loads (through clothing and shoes etc.) can thereby be dissipated.

Avant de connecter ou de déconnecter un appareil à le produit, le potentiel doit être égalisé (en touchant l'armoire électrique ou la borne de terre). Les charges électrostatiques (à travers les vêtements et les chaussures etc.) peuvent ainsi être éliminées.

12.2.2 Evaluating Operating Elements

The operating panel sends all statuses to the control, through which further actions can be set. Display (display, LEDs...) are initiated by the control.

The HGT 1053-3 sends the following operating element statuses to the safety-related control SCP XXX, which can evaluate and process the information.

- Key switch
- Emergency stop
- Confirmation switch

13 Transport/Storage

This device contains sensitive electronics. During transport and storage, high mechanical stress must therefore be avoided.

For storage and transport, the same values for humidity and vibration as for operation must be maintained!

Temperature and humidity fluctuations may occur during transport. Ensure that no moisture condenses in or on the device, by allowing the device to acclimate to the room temperature while turned off.

When sent, the device should be transported in the original packaging if possible. Otherwise, packaging should be selected that sufficiently protects the product from external mechanical influences. Such as cardboard filled with air cushioning.

14 Storage

When not in use, store the device according to the storage conditions. See chapter 13 Transport/Storage.

INFORMATION



During storage, ensure that all protective covers (if available) are placed correctly, so that no contamination, foreign bodies or fluids enter the device.

The existing battery in the device must be replaced after approx. 10 year/s. If the device is to be stored longer, the battery must be removed to prevent leakage.

15 Maintenance

During maintenance as well as servicing, observe the safety instructions from chapter 2 Basic Safety Directives.

15.1 Cleaning and Disinfecting the Touch Screen

CAUTION



Before cleaning and disinfecting the touch screen, it must first be deactivated; either by turning off the terminal or by disabling the touch screen via the application to avoid unintentionally activating functions or commands!

Avant de nettoyer et de désinfecter l'écran tactile, il faut d'abord le désactiver; soit en éteignant le terminal, soit en désactivant l'écran tactile via l'application pour éviter d'activer involontairement des fonctions ou des commandes!

The touch screen can only be cleaned with a soft, damp cloth. To dampen the cloth, a mild cleaning solution such as antistatic foam cleaner is recommended. To avoid fluids/cleaning solutions from getting into the housing, the device must not be sprayed directly. To clean, no erosive cleaning solutions, chemicals, abrasive cleansers or hard objects that can scratch or damage the touch screen may be used. The use of steam jets or compressed air is prohibited.

For disinfection, surface disinfectants on alcohol basis, which do not contain re-fattening agents, can be used. The disinfectant used must not leave any residues on the touch screen to ensure proper functioning of the touch screen.

WARNING



If the device is contaminated with toxic or erosive chemicals, it must be carefully cleaned as quickly as possible to prevent personal injury and machine damage!

Si l'appareil est contaminé par des produits chimiques toxiques ou érosifs, il doit être soigneusement nettoyé le plus rapidement possible afin d'éviter des dommages corporels et matériels!

INFORMATION



To ensure the optimal function of the device, the touch screen should be cleaned at regular intervals!

15.2 Service

This product was constructed for low-maintenance operation.

15.2.1 Calibrating the Touch Screen

The touch screen is calibrated at the factory. You should therefore only recalibrate the touch screen when press-point changes are noticed.

This can be achieved via the following command (depending on the operating system) or the application, if the application engineer has provided the option.

```
calib
```

15.3 Repair

In the event of a defect/repair, send the device with a detailed error description to the address listed at the beginning of this document.

For transport conditions, see chapter 13 Transport/Storage.

CAUTION



Danger of injury from damaged components!

- Damage to the device, especially the touch screen, poses a cut hazard. In such a case, use safety gloves.

Risque de blessure par des composants endommagés !

- Les dommages à l'appareil, en particulier à l'écran tactile, présentent un risque de coupure. Dans ce cas, utilisez des gants de sécurité.

16 Buffer Battery

A Lithium battery is installed at the manufacturer.

The battery has enough capacity to preserve data in the absence of a supply voltage for up to circa 10 year/s.

	COMPANY	DATA
Lithium battery	RENATA	3.0 V/225 mAh

INFORMATION



Battery order number: 01-690-055

Use type CR2032 batteries from RENATA only.

WARNING



Danger of fire and explosion!

- Battery may explode if mistreated. Do not recharge, disassemble or dispose of in fire.
- Replace battery with cat. no. CR2032 manufactured by RENATA only. Use of another battery may present a risk of fire or explosion. See instruction manual for safety instructions.

Danger d'incendie et d'explosion !

- La batterie peut exploser si elle n'est pas manipulée correctement.
- Ne pas la recharger, la démonter ou la jeter au feu. Ne remplacez la pile que par la référence CR2032, fabriquée par RENATA. L'utilisation d'une autre pile présente un risque d'incendie ou d'explosion. Vous trouverez les consignes de sécurité dans le mode d'emploi.

16.1 Data Retention Battery Change


The exchangeable buffer battery ensures that the following data is preserved in the absence of a supply voltage:

- Time

If the battery is empty, the following settings are reset or data is deleted:


- Time (reset to default value)

16.2 Exchanging the Battery

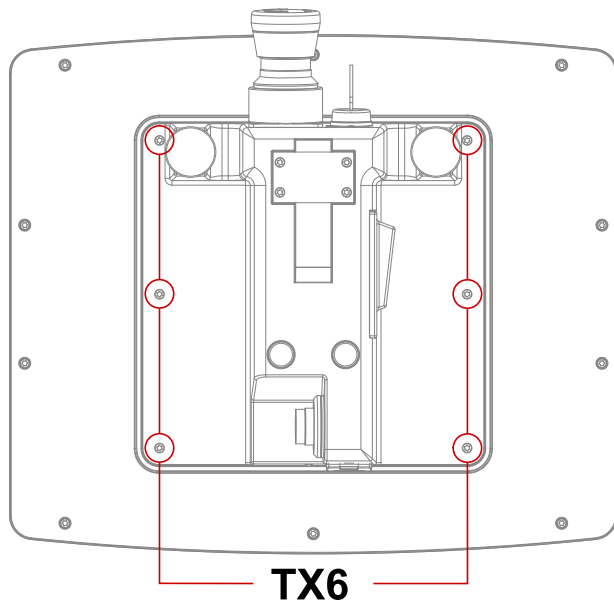

1. Turn off the device supply.
2. Create ESD-compliant conditions.
3. Remove the locking screws with a Torx screwdriver.

4. Carefully lift the cover to avoid damaging the connecting cable between the housing sections and access the battery holder.

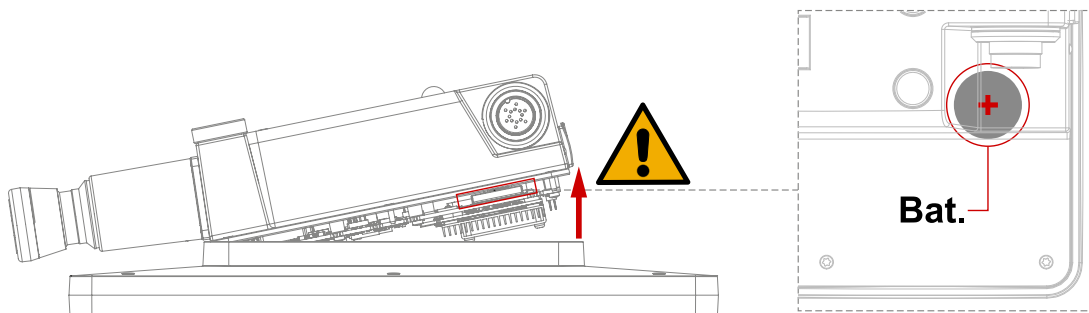


5. Remove the battery from the holder.
6. Install the new battery with the correct polarity (+ pole facing up, away from the circuit board).
7. Close the cover (caution, connecting cable) and tighten the locking screws (0.2 Nm).

17 microSD Card



The 10.1" Handheld Operating Panel has a microSD card slot inside the device.

17.1 Exchanging the microSD Card

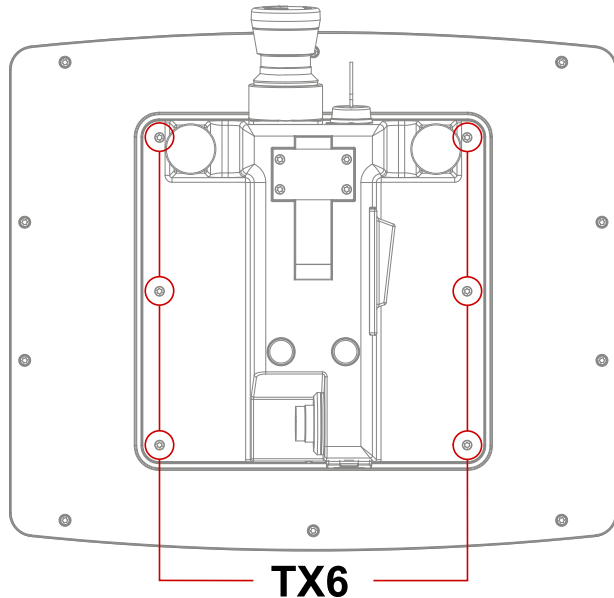


1. Turn off the device supply.
2. Create ESD-compliant conditions.
3. Remove the locking screws with a Torx screwdriver.

4. Carefully lift the cover to avoid damaging the connecting cable between the housing sections and access the microSD holder. The card holder is located below the fan.

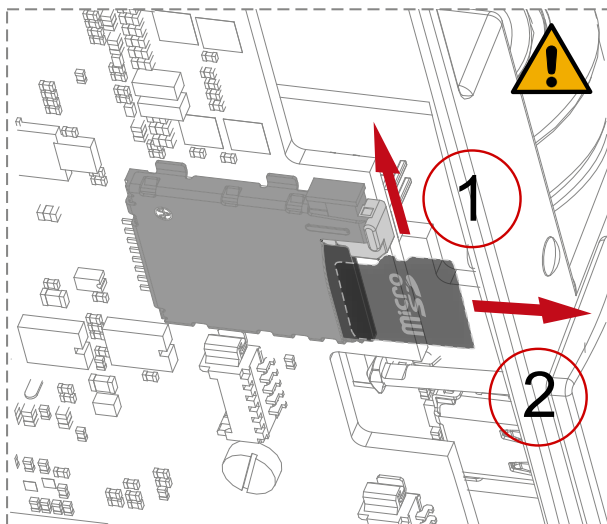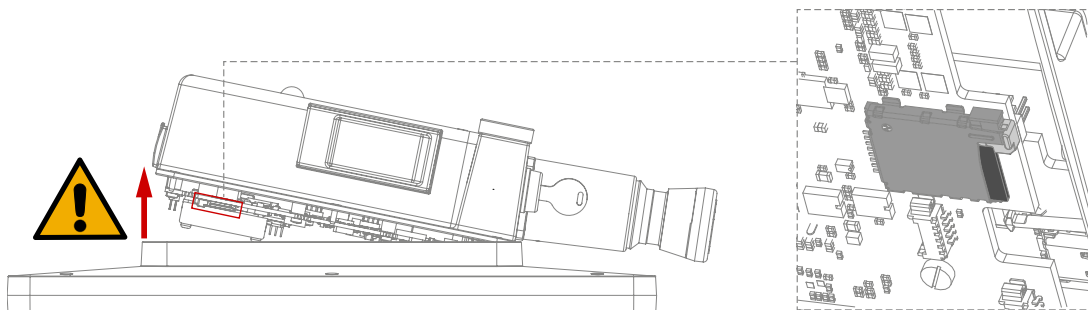

5. Carefully press the lock on the side (caution: card springs out due to mechanism).
6. Remove card.

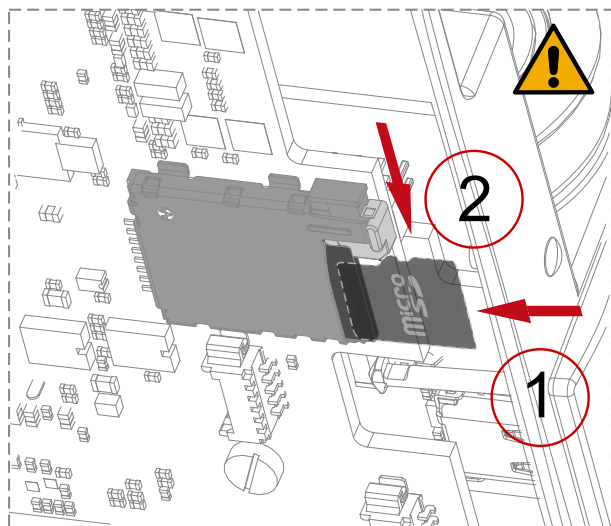

7. Insert the new microSD card.
8. Ensure that the latch is completely engaged.

9. Close the cover (caution, connecting cable) and tighten the locking screws (0.2 Nm).

18 Display „Burn-In“ Effect

The “Burn-In” effect describes a pattern burned into the display after displaying the same contents over a longer period of time (e.g. a single screen).

This effect is also described mostly as “image sticking”, “memory effect/sticking” or “ghost image”.

Here, a distinction is made between a temporary and permanent effect, while the temporary effect is eliminated by switching off the screen for a longer period of time or by displaying dynamic content, serious cases of burn-in can lead to permanent damage to the display.

This effect can have the following causes:

- Operation without a screen saver
- The same contents displayed over a longer time period (e.g. a single screen)
- Operation at high environmental temperatures
- Operation above specifications

The effect can be avoided/reduced by the following actions:

- Using a screen saver
- Deactivating the display when not in use (e.g. screen display black)
- Continuously changing screen content (e.g. video)

INFORMATION



Deactivating the display backlighting only does not prevent Burn-In!

18.1 Screen Saver

The device has an integrated screen saver, which is activated by default and turns off the screen after 60 minutes of inactivity. The screen can be reactivated with an input via the touch screen or a USB operating device. The wait time for the screen saver can be adjusted in the application via the HW class. This change is only active as long as the device is running the application, in Reset mode, the 60-minute default setting is restored.

19 Disposal



INFORMATION

Should you need to dispose of the device, the national regulations for disposal must be followed.

The device appliance must not be disposed of as household waste.



20 Accessories

20.1 Touch Pen



Description	Order Number
Touch pen with holder V3	01-690-059-3

20.2 Edge Protection



Description	Order Number
Edge protector 10"	12-246-1033-Z1

20.3 Battery



Description	Order Number
Lithium battery RENATA	01-690-055

20.4 microSD Card



Description	Order Number
8 Gbyte	12-630-803

The microSD card is delivered empty and unformatted. For actual memory usage and formatting format, see performance data.

21 Application Information

21.1 Configuring Safety Components

21.1.1 Minimum System Requirements

Component	Version
SAFETYDesigner	≥ 01.01.056 (Build: 2058)
SCP XXX firmware version	≥ 00.1049.448

INFORMATION



The actual time-out configured in the SCP XXX must be included in your risk assessment!

21.1.2 Adding the HGT 1053-3 to a SAFETYDesigner Project

To use the HGT 1053-3 in a Safety project, it must be integrated as follows:

1. Create a new project or open an existing one.
2. Add an "SCP XXX" to the "hardware tree" if not already available.
3. Right-click on „**0-SAFETY_INTERFACE**“, then via Add-Device, add the „**HBG (HBG-CAN)**“.

21.1.3 Key Switch

In the SAFETYDesigner **Safe_Input5** and **Safe_Input6** are used for the two-channel application of the key switch.

21.1.4 Confirmation Switch

In the SAFETYDesigner **Safe_Input1** and **Safe_Input2** are used for the two-channel application of the confirmation switch.

21.1.5 Emergency Stop

In the SAFETYDesigner **Safe_Input3** and **Safe_Input4** are used for the two-channel application of the emergency stop switch.

DANGER



Unlocking the emergency stop switch cannot trigger an automatic restart of the machine.

Le déverrouillage de l'interrupteur d'arrêt d'urgence ne peut pas déclencher un redémarrage automatique de la machine.

After the application unlocks the emergency stop switch, the operator must be prompted to run a defined activation process.

Après que l'application ait déverrouillé l'interrupteur d'arrêt d'urgence, l'opérateur doit être invité à exécuter un processus d'activation défini.

21.2 Storage Media

The operating system and customer application are stored on the internal storage device.

INFORMATION



At least 1 Gbyte of the total memory must be reserved for the update process (packages).

To ensure longevity of the memory, writing cyclic data to the internal storage medium should be avoided (lifespan drastically reduced). For cyclic writing, an external storage medium (e.g. microSD card or USB stick, depending on the respective device) from SIGMATEK must be used.

Errors resulting from the use of storage media from other manufacturers are excluded from support.

21.2.1 Create Boot Media (Make Bootdisk)


To create a boot medium with a SIGMATEK operating system, the PlcDiag function “Make Bootdisk” must be used. For the corresponding formatting of the storage medium, the storage medium identifier must be entered in addition to the operating system image.

HW version	Storage media identification	Storage media designation
≥ HW: 1.10	100 (microSD)	8-Gbyte microSD (16-Gbyte 2:1 formatted ~60k P/E cycles)
< HW: 1.10	101 (microSD)	8-Gbyte microSD (8-Gbyte 1:1 formatted ~3k P/E cycles)

Customer-specific data can then be copied to the storage medium.

21.2.2 Lifetime Calculation (Flash Media Lifetime Calculation)

The life span of the internally installed storage medium can be calculated using the Flash Media Lifetime Calculation Tool. This is a theoretical guideline value. The storage medium ID must be entered to ensure the correct selection. The current status of the storage medium can be read out via the hardware class “PLC_Info” using the “SDCardHealth” server.

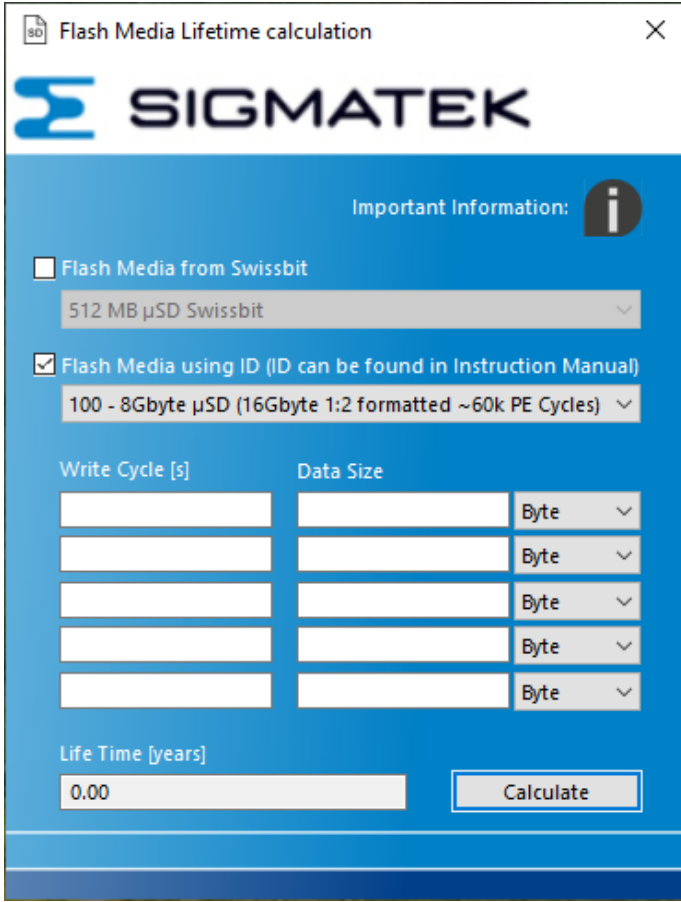

The screenshot shows the 'Flash Media Lifetime calculation' window. It features the Sigmatek logo and an 'Important Information' icon. There are two main selection options: 'Flash Media from Swissbit' (unchecked) and 'Flash Media using ID (ID can be found in Instruction Manual)' (checked). Under the checked option, a dropdown menu shows '100 - 8Gbyte µSD (16Gbyte 1:2 formatted ~60k PE Cycles)'. Below this, there are five rows of input fields for 'Write Cycle [s]' and 'Data Size', each with a 'Byte' unit selector. At the bottom, a 'Life Time [years]' field shows '0.00' and a 'Calculate' button.

INFORMATION



These extended functions of Make Bootdisk and Flash Media Lifetime Calculation are available from LASAL CLASS 2 version 02.02.244.

21.3 HW Facts

INFORMATION



The Safety functions must be used with the SCP XXX exclusively! The status of the safety-related inputs (confirmation switch, key switch, emergency stop switch) is sent to the SCP XXX, which decodes these functions and makes them available for further use.

The key switch must be tested at least once per year. For the emergency stop and confirmation switches, the operator must be prompted every 30 days to run a test!

Changes Chart

Change date	Affected page(s)	Chapter	Note
22.07.2025	15	5.1 Performance Data	microSD size and info adjusted
	54	20.4 microSD Card	Text
	56	21.2 Storage Media	Chapter "Create Boot Medium" and "Lifetime Calculation" added
06.08.2026		Document	UL certification